


Item No.	Construction Code	Actual Size (Inches) (H x W x D)	Efficiency (Eff% @ X Microns)	Rated Air Flow (CFM) @ 90 FPM
2995949	H2222K22-0NPF10W36	22-1/4 x 22-1/4 x 4-3/4	99.99% @ 0.3	260
2597476	H2222K22-0NPF10WD6	22-1/4 x 22-1/4 x 4-3/4	99.999% @ 0.3	260
2697478	H2222K22-0NPF10WF6	22-1/4 x 22-1/4 x 4-3/4	99.9995% @ 0.12	260
2995953	H2246K22-0NPF10W36	22-1/4 x 46-1/4 x 4-3/4	99.99% @ 0.3	575
2597475	H2246K22-0NPF10WD6	22-1/4 x 46-1/4 x 4-3/4	99.999% @ 0.3	575
2697477	H2246K22-0NPF10WF6	22-1/4 x 46-1/4 x 4-3/4	99.9995% @ 0.12	575

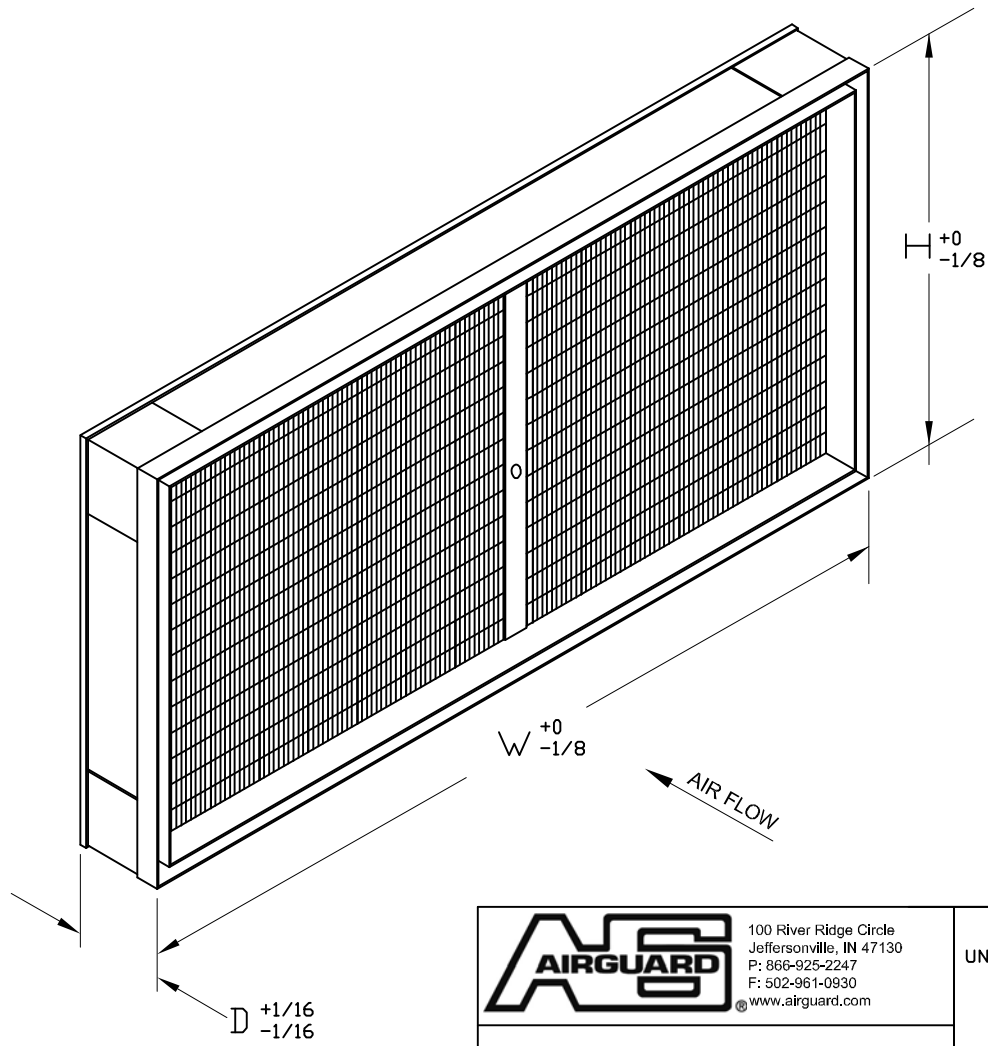

STANDARD CONSTRUCTION

1. MEDIA: MICRO-GLASS FIBER / ACRYLIC RESIN BINDER
2. FRAME: ANODIZED EXTRUDED ALUMINUM, 4-PIECE BOX CONSTRUCTION
3. GASKET MATERIAL: CHANNEL WITH URETHANE GEL UPSTREAM (155 DEG. F)
4. SEALANT: URETHANE (180 DEG F)
5. CENTERPOST: ONE ACCESS PORT
6. FACEGUARD: WHITE EXPANDED METAL - DOWNSTREAM
7. SEPARATORS: MINI-PLEAT BEAD SEPARATORS - 2" (54 mm) (160 DEG. F)

NOTES

1. CERTIFICATION: IEST-RP-CC001.4
2. RATED VELOCITY: 90 FPM
3. RECOMMEND FINAL RESISTANCE: TWICE INITIAL RESISTANCE
4. HOUSINGS AND FILTERS SOLD SEPARATELY
5. (4) FILTER RETAINERS INCLUDED WITH HOUSING
6. MAXIMUM OPERATING TEMPERATURE: 160 DEG. F
7. CLASS 2 FILTER PER U.L. STANDARD 900
8. FOR HOUSING DETAIL SEE MKT-B-00626 AND MKT-B-00627



100 River Ridge Circle
Jeffersonville, IN 47130
P: 866-925-2247
F: 502-961-0930
www.airguard.com

**CONTACT FACTORY TO
VERIFY REVISION LEVEL**

**TOLERANCES
UNLESS OTHERWISE SPECIFIED**

FRACTIONAL	-
DECIMAL	-
ANGLES	-

ALL DIMENSIONS IN INCHES

DRAWING NAME MICRO+PLUS ROOMSIDE REPLACABLE FILTERS			
APPROVED BY <i>K. Quinn</i>	SPECIFICATION NO. MKT-B-00628	PAGE 1 OF 1	
SCALE NONE	DWG. SIZE A	REVISION NEW	REVISION DATE 07-22-11
<small>CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.</small>			